

EXAMPLE - SIMPLE

California Standardized Prescribed Fire Plan

Project Title: Doe Property Burn

Property Owner: John and Jenny Doe

Date Created: 4/1/23 Date Re-Evaluated* (if applicable): _____

1. Project Area Description

Location Description: 25 Pretty Lane, Nevada City (unincorporated)
CA 95959

Latitude and longitude (in Degrees Decimal Minutes (DMM)):

Latitude: _____ Longitude: _____

Property Ownership (private, state, etc.): private

Unit Size (acres): 1 1/2

Unit Description:

Pine/black oak, gentle slope, west-facing

Prescribed fire goals and objectives

Reduce fire hazard, fuels
Restore forest

2. Pre-burn Considerations

Plan for unit preparation (describe line type/construction, pre-treatment of fuels, pre-burn land management considerations (e.g., grazing deferment), etc.):

Roads and trails around area. Rake, use blower, weedeat on road/trail edges, Trim branches in 5 feet.

Water supply (describe quantity, location, and other considerations):

Garden hose, on 2 sides, Truck with portable water tank & pump & hose at corner on other side.

Unit access (describe roads, signage needs, etc.): Off straight road, 1-mile from Hwy 49.

Plan to protect values at risk (if applicable; e.g., structures, water lines, sensitive species, cultural sites, etc.): Defensible space around home

3. Prescription

Temperature < 75°, winds < 3 miles/hour
Relative humidity > 25%

7. Notifications

Pre-Burn and Day of Burn Notifications:

Adjacent Landowners

- Name: Sue Smith Phone: 333-333-3333
- Name: Jeff Good Phone: 222-222-2222
- Name: Slate Family Phone: 111-111-1111

Air Quality Management District

- Name/Title: N. Sierra Air Quality District Phone: 530-274-9360

Fire Agency Having Jurisdiction

- Name/Title: Consolidated Fire Phone: 530-265-4431 ^{week days}
_{or nearby station weekend}

CAL FIRE Emergency Command Center (ECC):

- Name/Title: Grass Valley ECC Phone: 530-477-0641

8. Wildfire Conversion Plan

Person(s) to contact for declaration:


Name/Position: Jhn & Jenny Doe Phone/frequency: 888-888-8888

9. Risk Management Activities

Check boxes for risk management activities/plans attached to the prescribed fire plan:

- Contingency plan (required) Call ECC

Doe Property Burn map

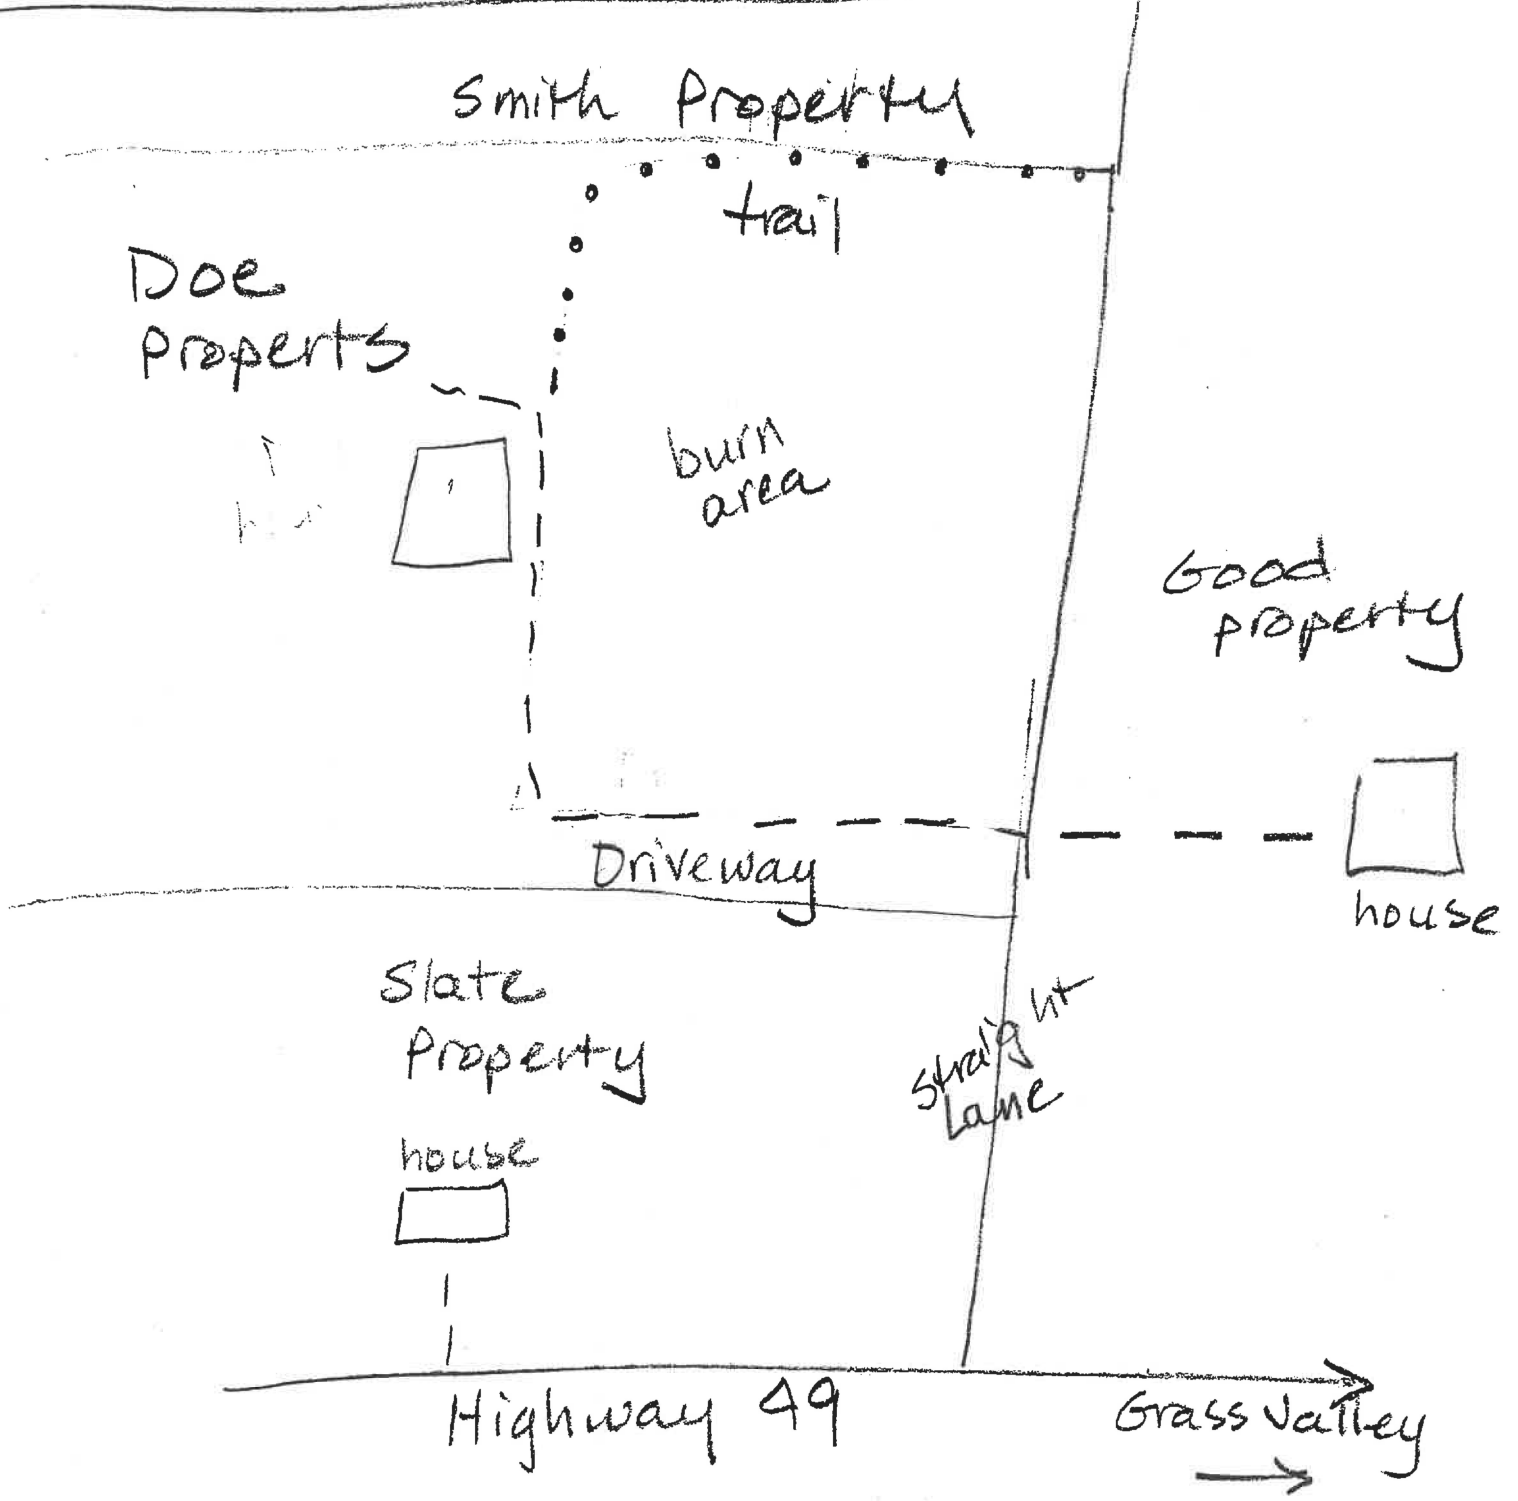

Element 2, Part 2: Prescribed Fire GO/NO-GO Checklist

(Prescribed Fire Plan: Element 2B)

* Preliminary Questions	YES	NO
<p>A. Have conditions in or adjacent to the ignition unit changed, (for example: drought conditions or fuel loadings), which were not considered in the prescription development?</p> <ul style="list-style-type: none"> • If YES go to Item B. • If NO proceed with the Go/NO-GO Checklist below, 		
<p>B. Has the prescribed fire plan been reviewed and an amendment been approved; or has it been determined that no amendment is necessary?</p> <ul style="list-style-type: none"> • If YES, proceed with the checklist below. • If NO, STOP: Implementation is not allowed. An amendment is needed. 		
GO/NO-GO Checklist	YES	NO
Have ALL permits and clearances been obtained?		
Have ALL the required notifications been made?		
Have ALL the pre-burn considerations and preparation work identified in the prescribed fire plan been completed or addressed and checked?		
Have ALL required current and projected fire weather forecasts been obtained and are they favorable?		
Are ALL prescription parameters met?		
Are ALL smoke management specifications met?		
Are ALL planned operations personnel and equipment on-site, available and operational?		
Has the availability of contingency resources applicable to today's implementation been checked and are they available?		
Have ALL personnel been briefed on the project objectives, their assignment, safety hazards, escape routes, and safety zones?		
<p>If all the questions were answered "YES" proceed with a test fire. Document the current conditions, location and results. If any questions were answered "NO", DO NOT proceed with the test fire: Implementation is not allowed.</p>		
<p>After evaluating the test fire, in your judgment can the prescribed fire be carried out according to the prescribed fire plan and will it meet the planned objective? Circle: YES or NO</p>		

Burn Boss Signature: _____ Date: _____